
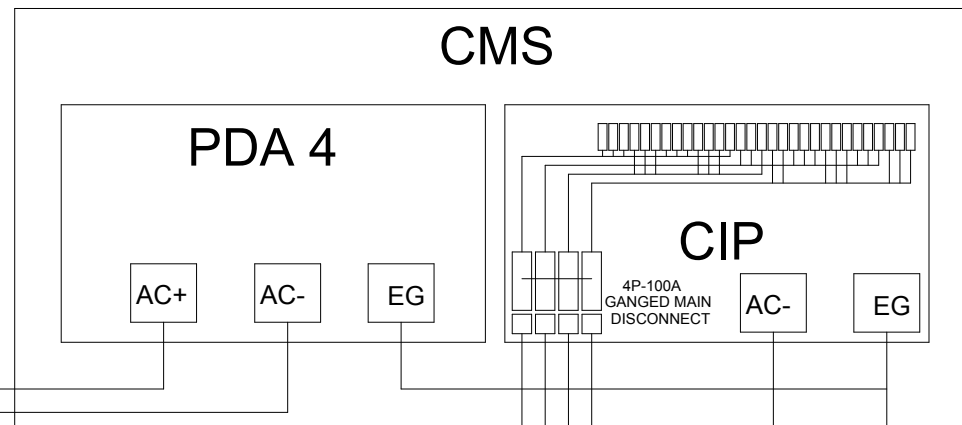


TRANSFORMER ENCLOSURE
LOCATED AT BASE OF CMS POLE
OR NEXT TO THE SERVICE CABINET
AT DISTRICT'S DISCRETION

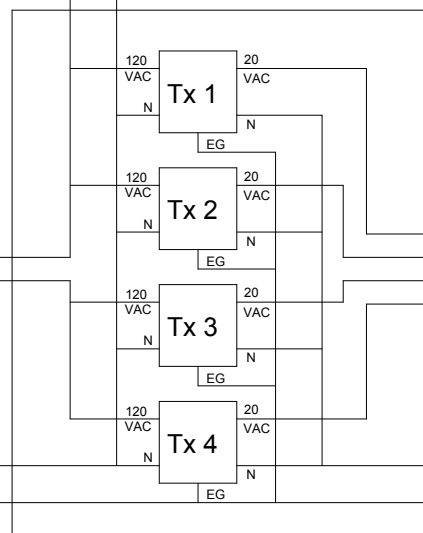

MODELS 500/510 CMS SYSTEMS		
Title: Xenon Retrofit Transformer to CIP		
Wiring Detail		
Sheet 1 of 1	Date: MAY 1998	Page: 8 - 8 - 2C